


MEDIUM VOLTAGE AMP-TRAP FUSE
PEAK LET THRU CURRENT DATA
BOLT-IN 15.5KV
CAT. NO. A155B3DORO-300E

FERRAZ SHAWMUT
NEWBURYPORT, MA 01950

720662

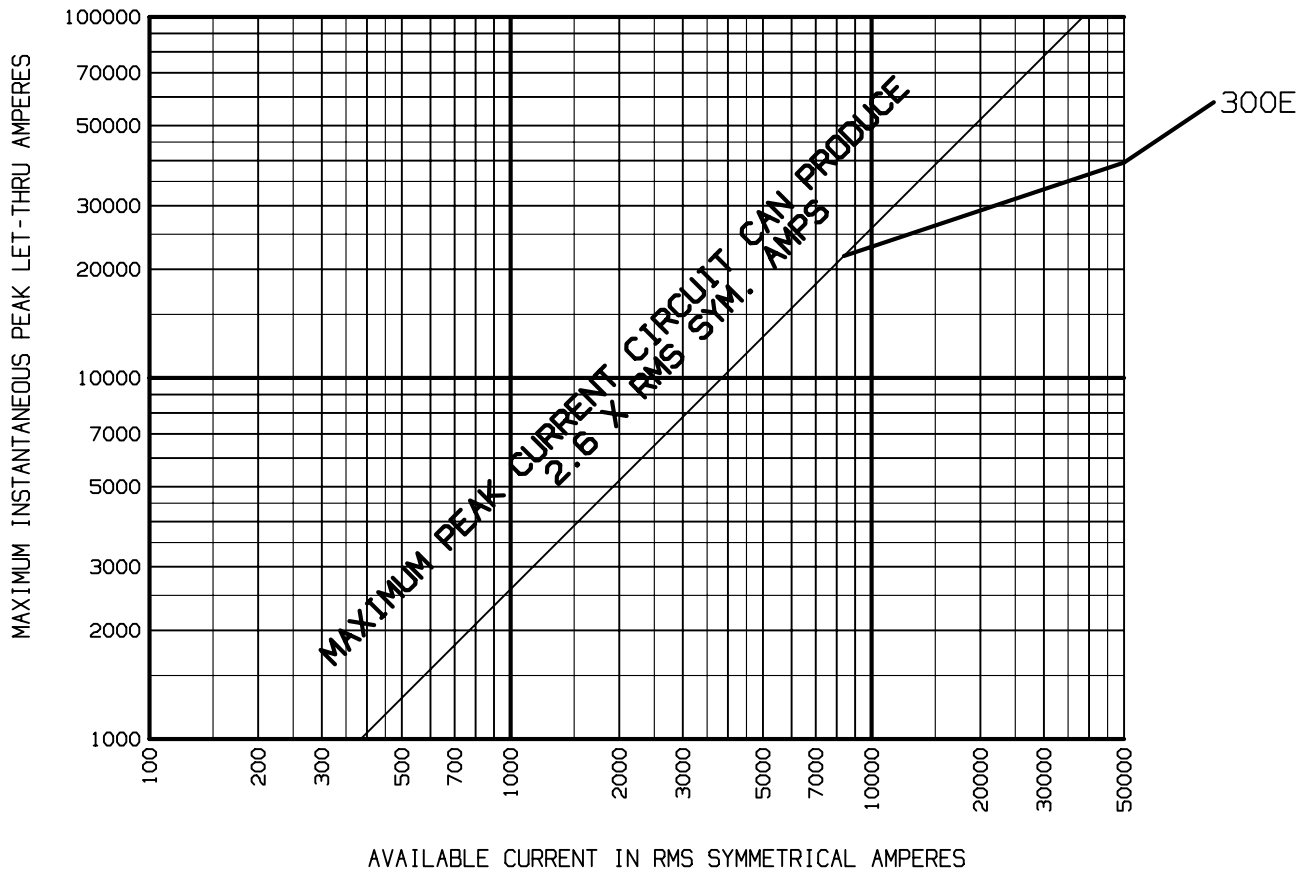

CONTROL NO.: 742
REV: -
FOLDER NO.: 14A
3/18/05