CONTROL NUMBER: 30

REV. -
02/24/98

TIME DELAY CC FUSE

ATQR(AMP. RATING)
$\frac{3}{16}$ - $1\frac{8}{10}$A 600 VOLTS

MELTING TIME-CURRENT DATA

MERSEN
Newburyport, MA 01950

106766

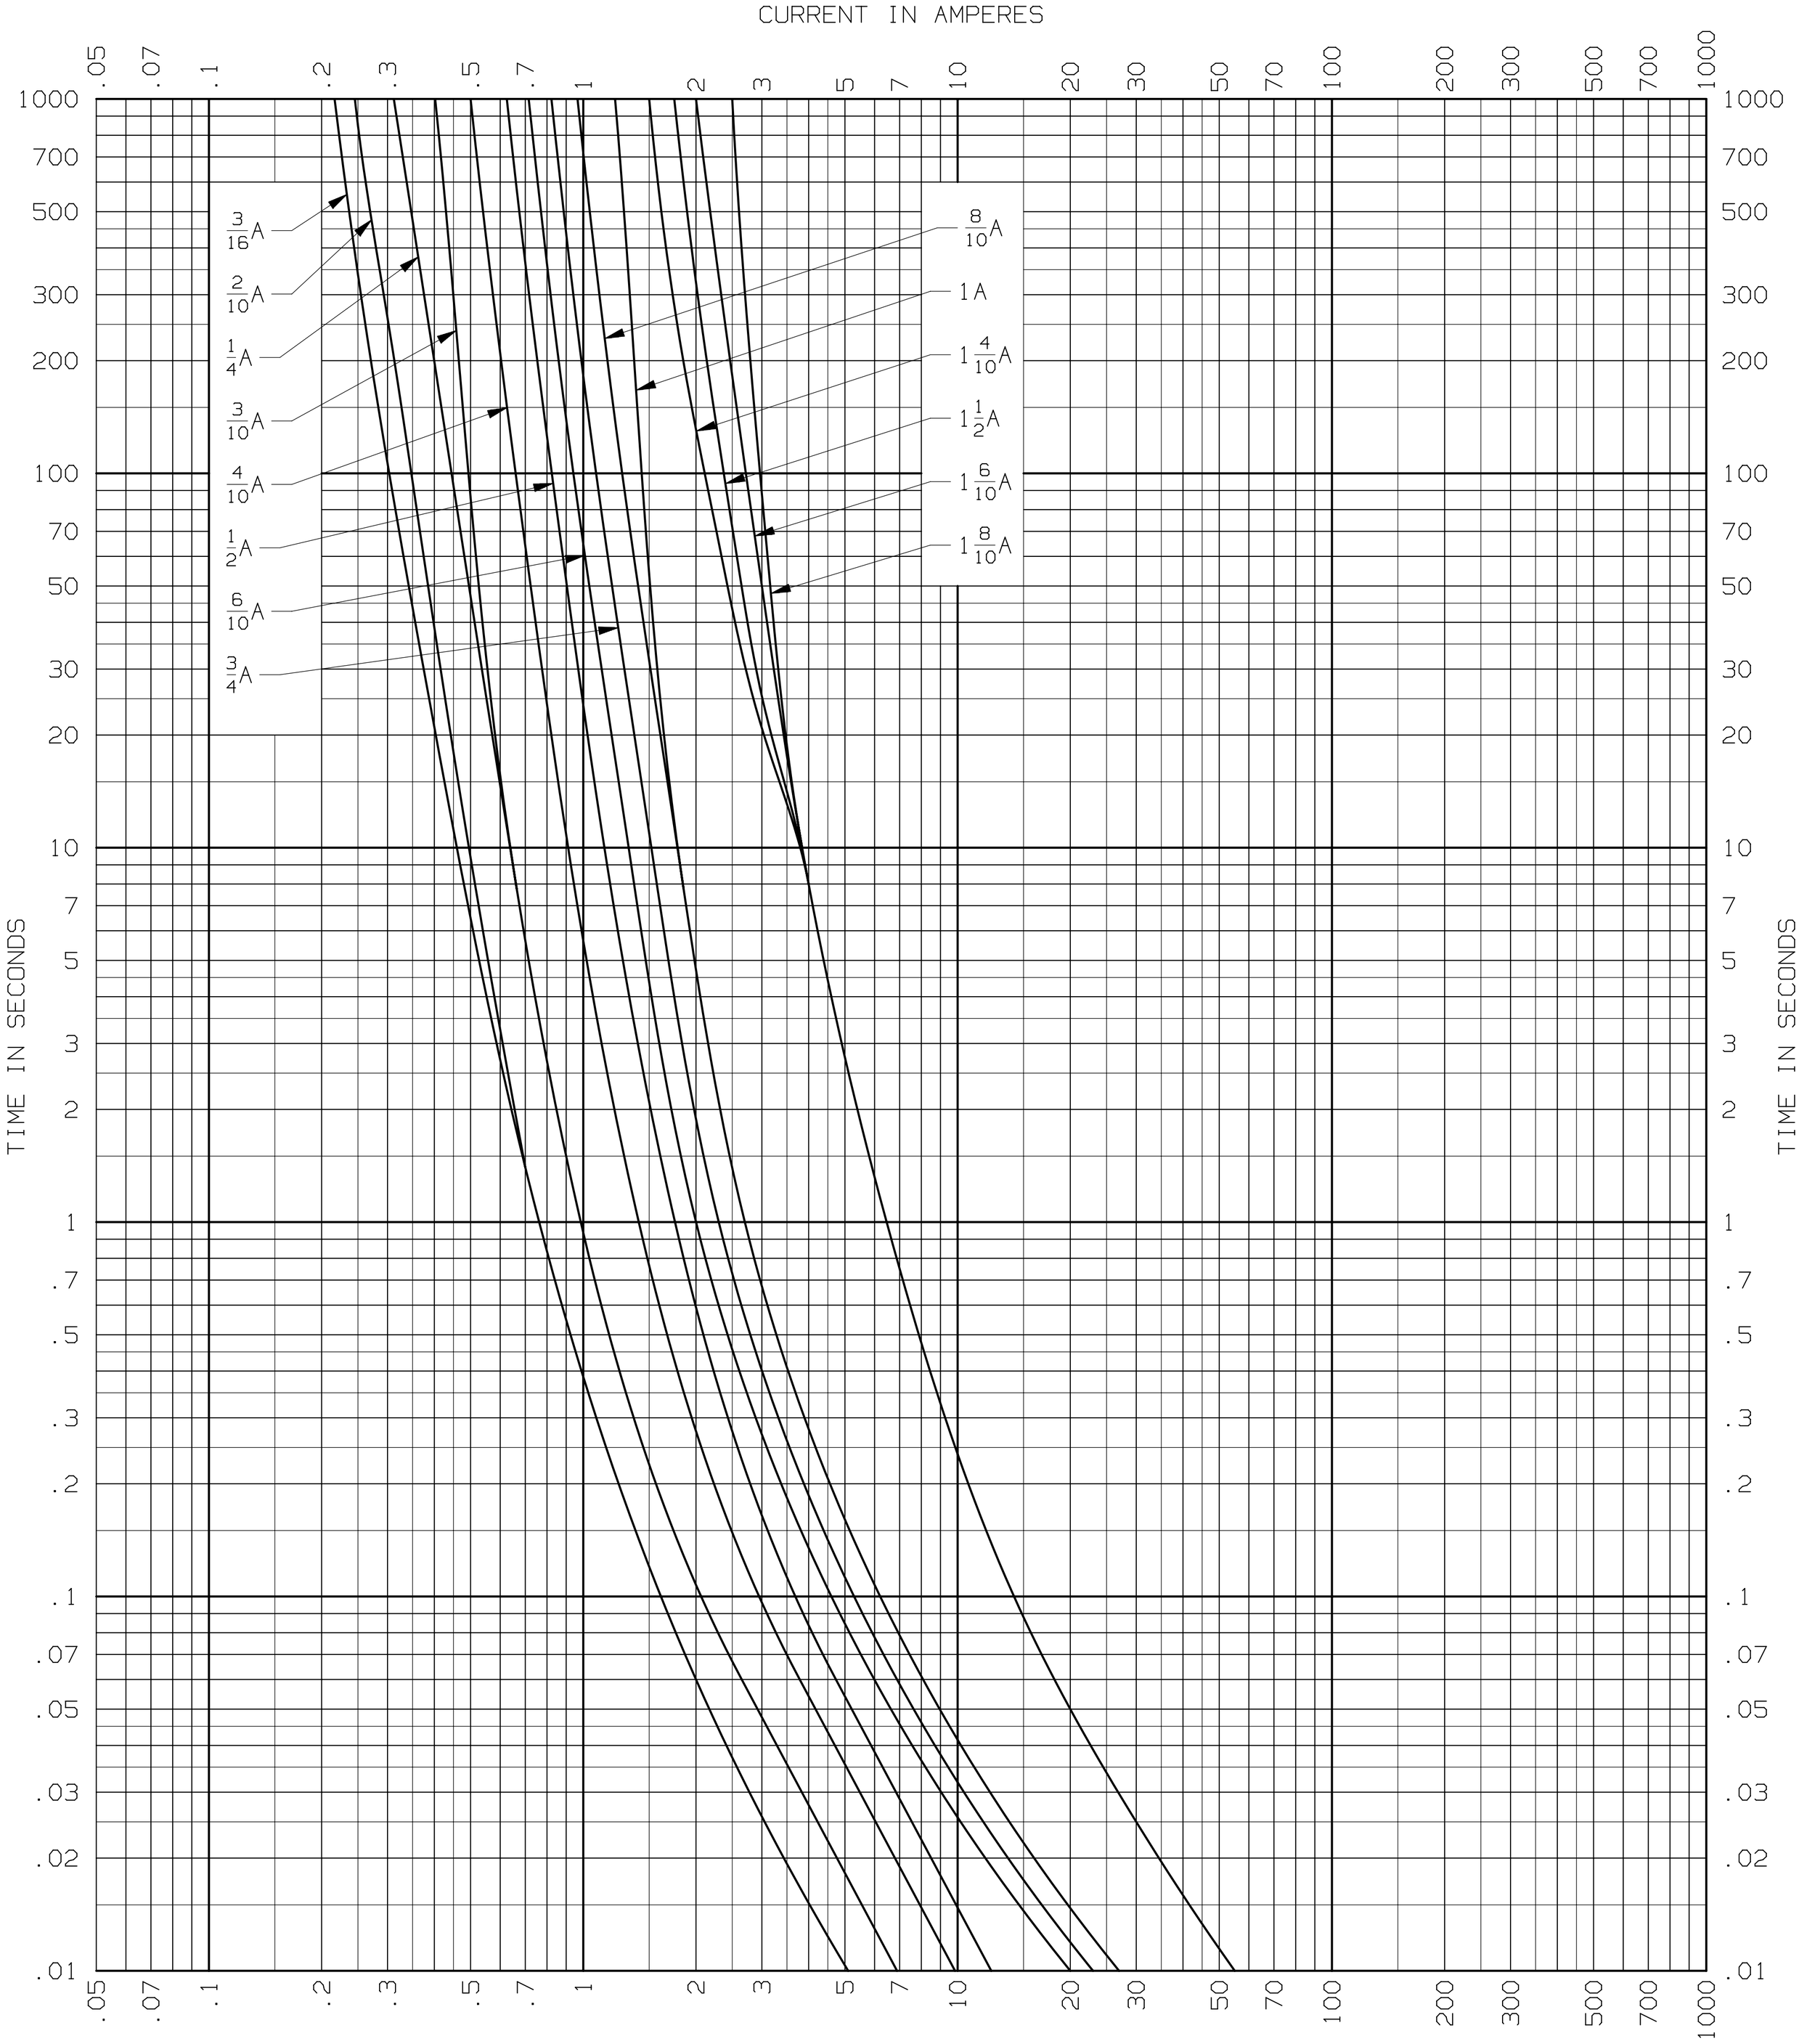

CURRENT IN AMPERES