

FORM 600 TIME DELAY FUSE  
MELTING TIME CURRENT DATA  
5.6-30 AMPS 500 VOLTS 10KA I.C.  
CAT. NO. ATQ (AMP RATING)




Newburyport, MA 01950

48412

REV A  
01APR97

CURRENT IN AMPERES

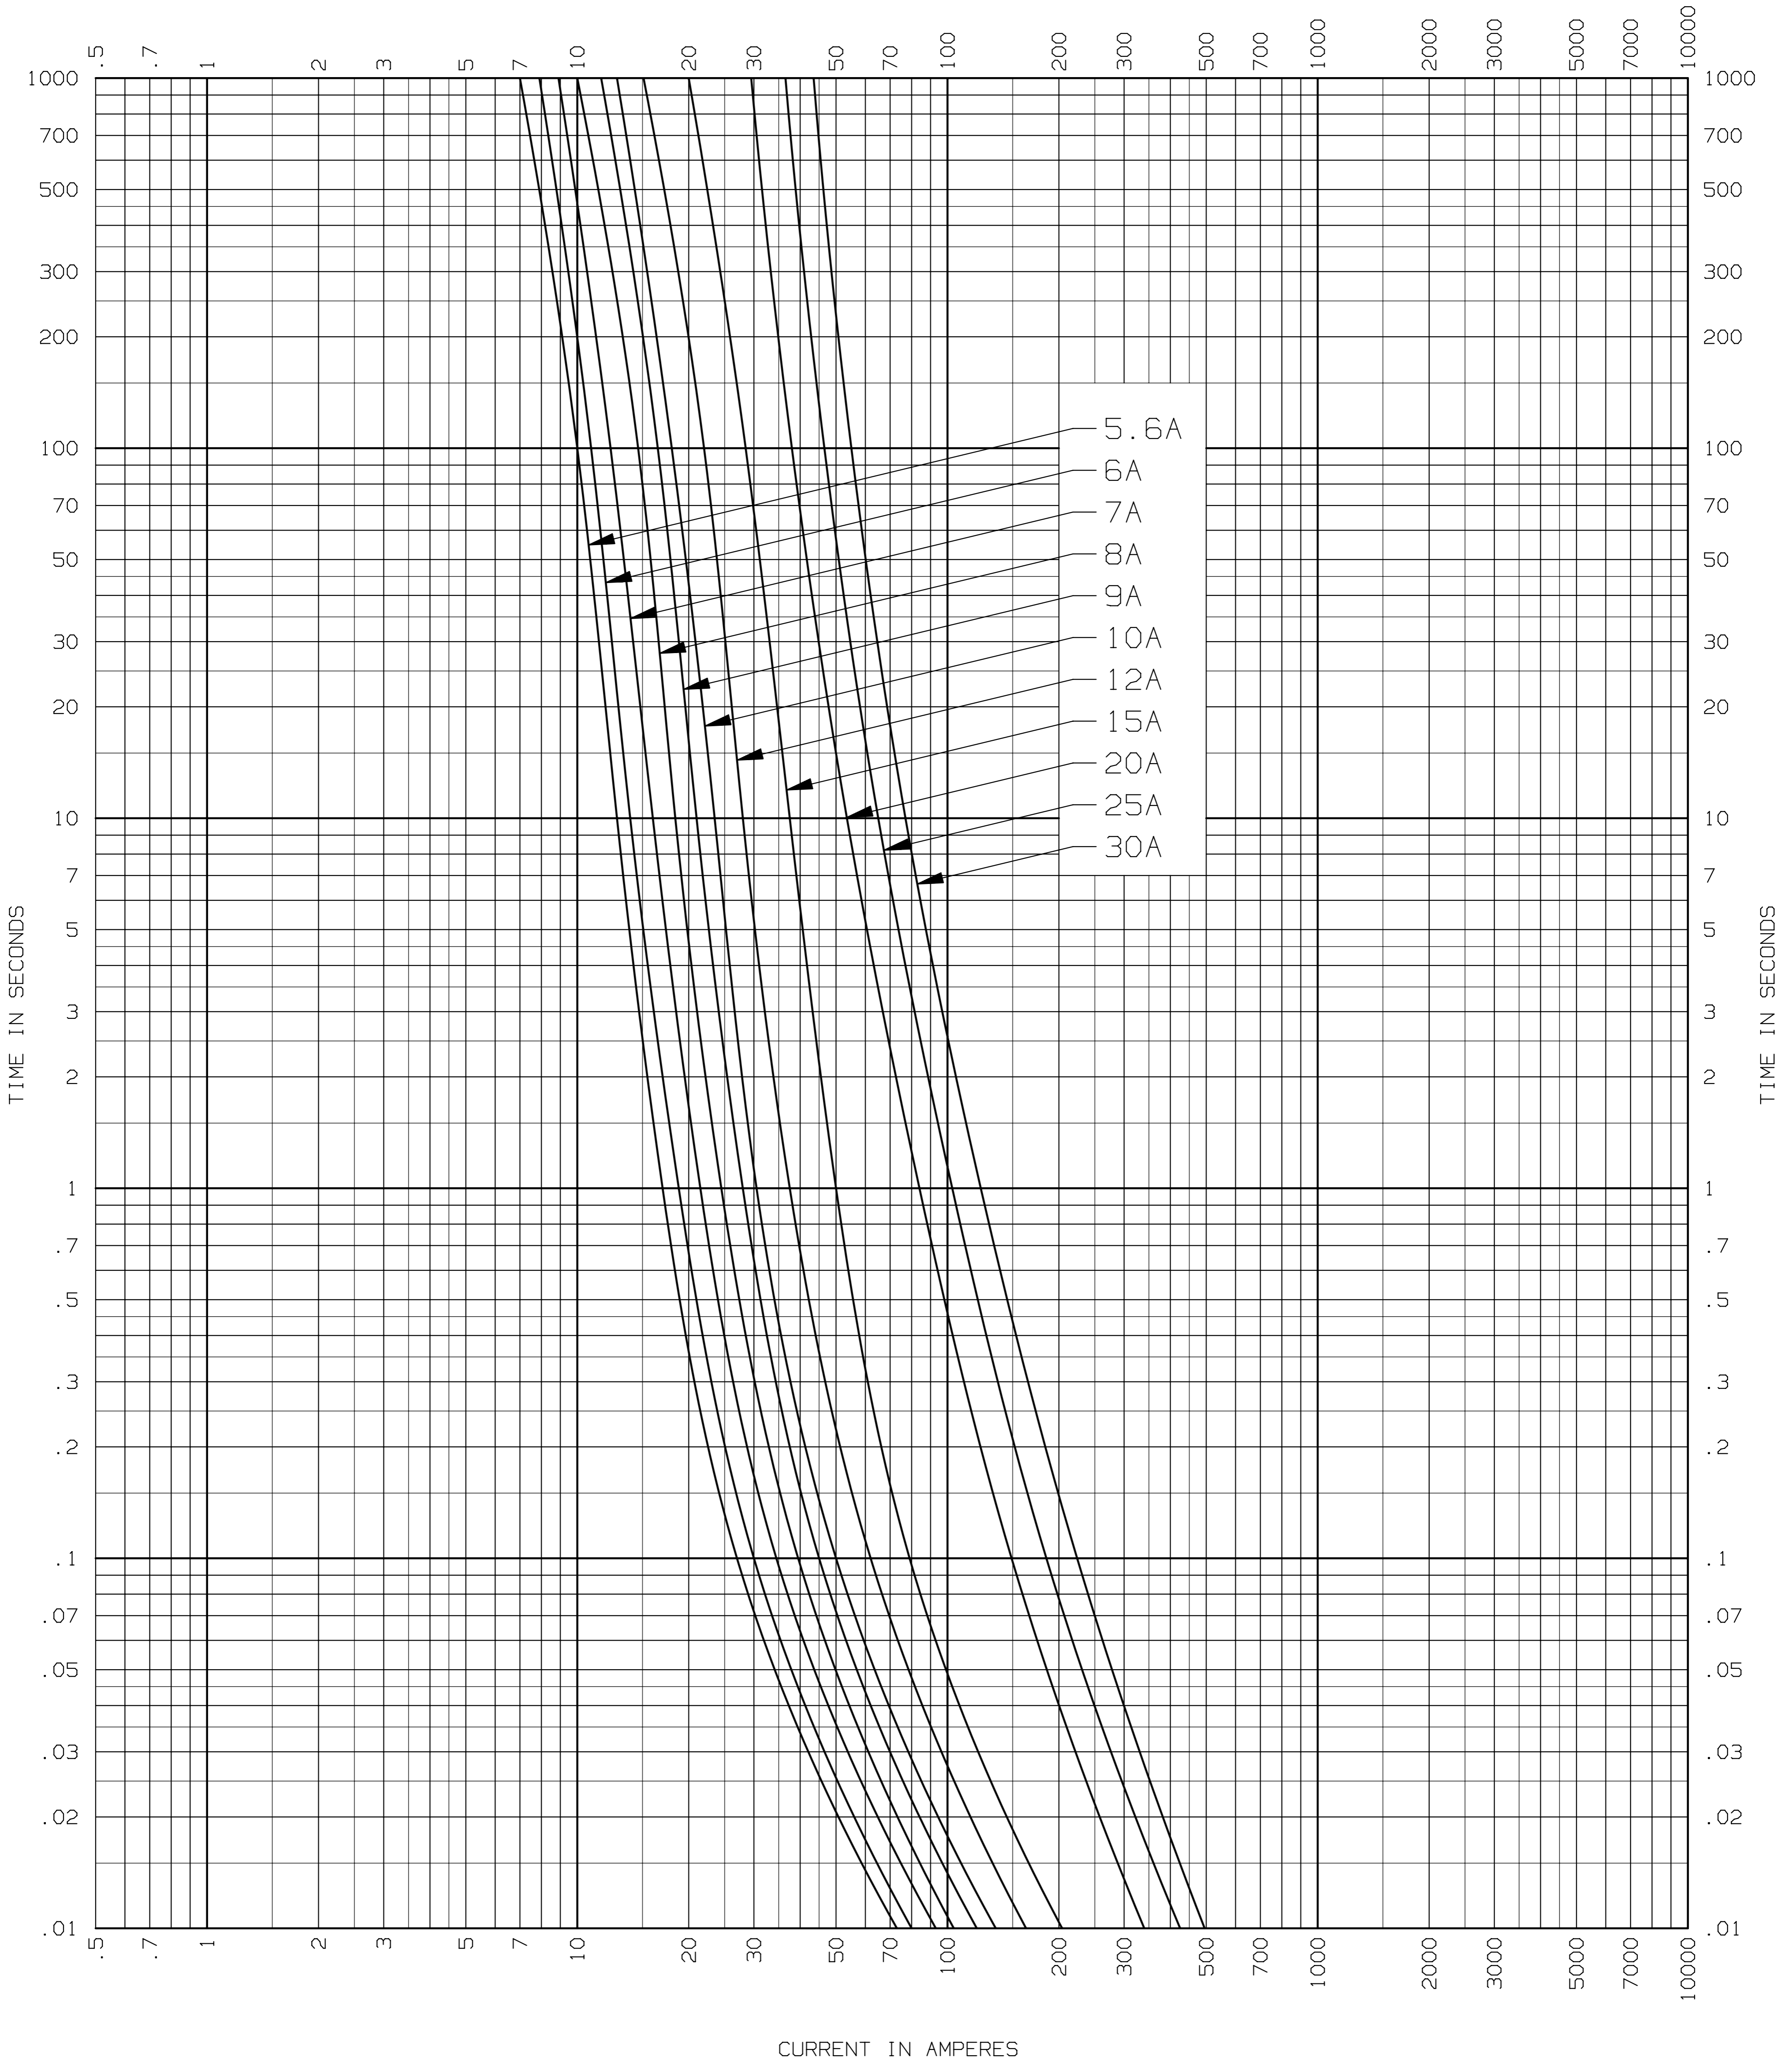

CURRENT IN AMPERES