

MEDIUM VOLTAGE AMP-TRAP FUSE


A055B2D0R0 - { 450-600 } E
A055B2DCR0 - { 450-600 } E

BOLT-IN 5.5KV

TOTAL CLEARING TIME CURRENT CURVE

MERSEN USA NEWBURYPORT-MA, LLC
374 MERRIMAC STREET
NEWBURYPORT, MA 01950

720455

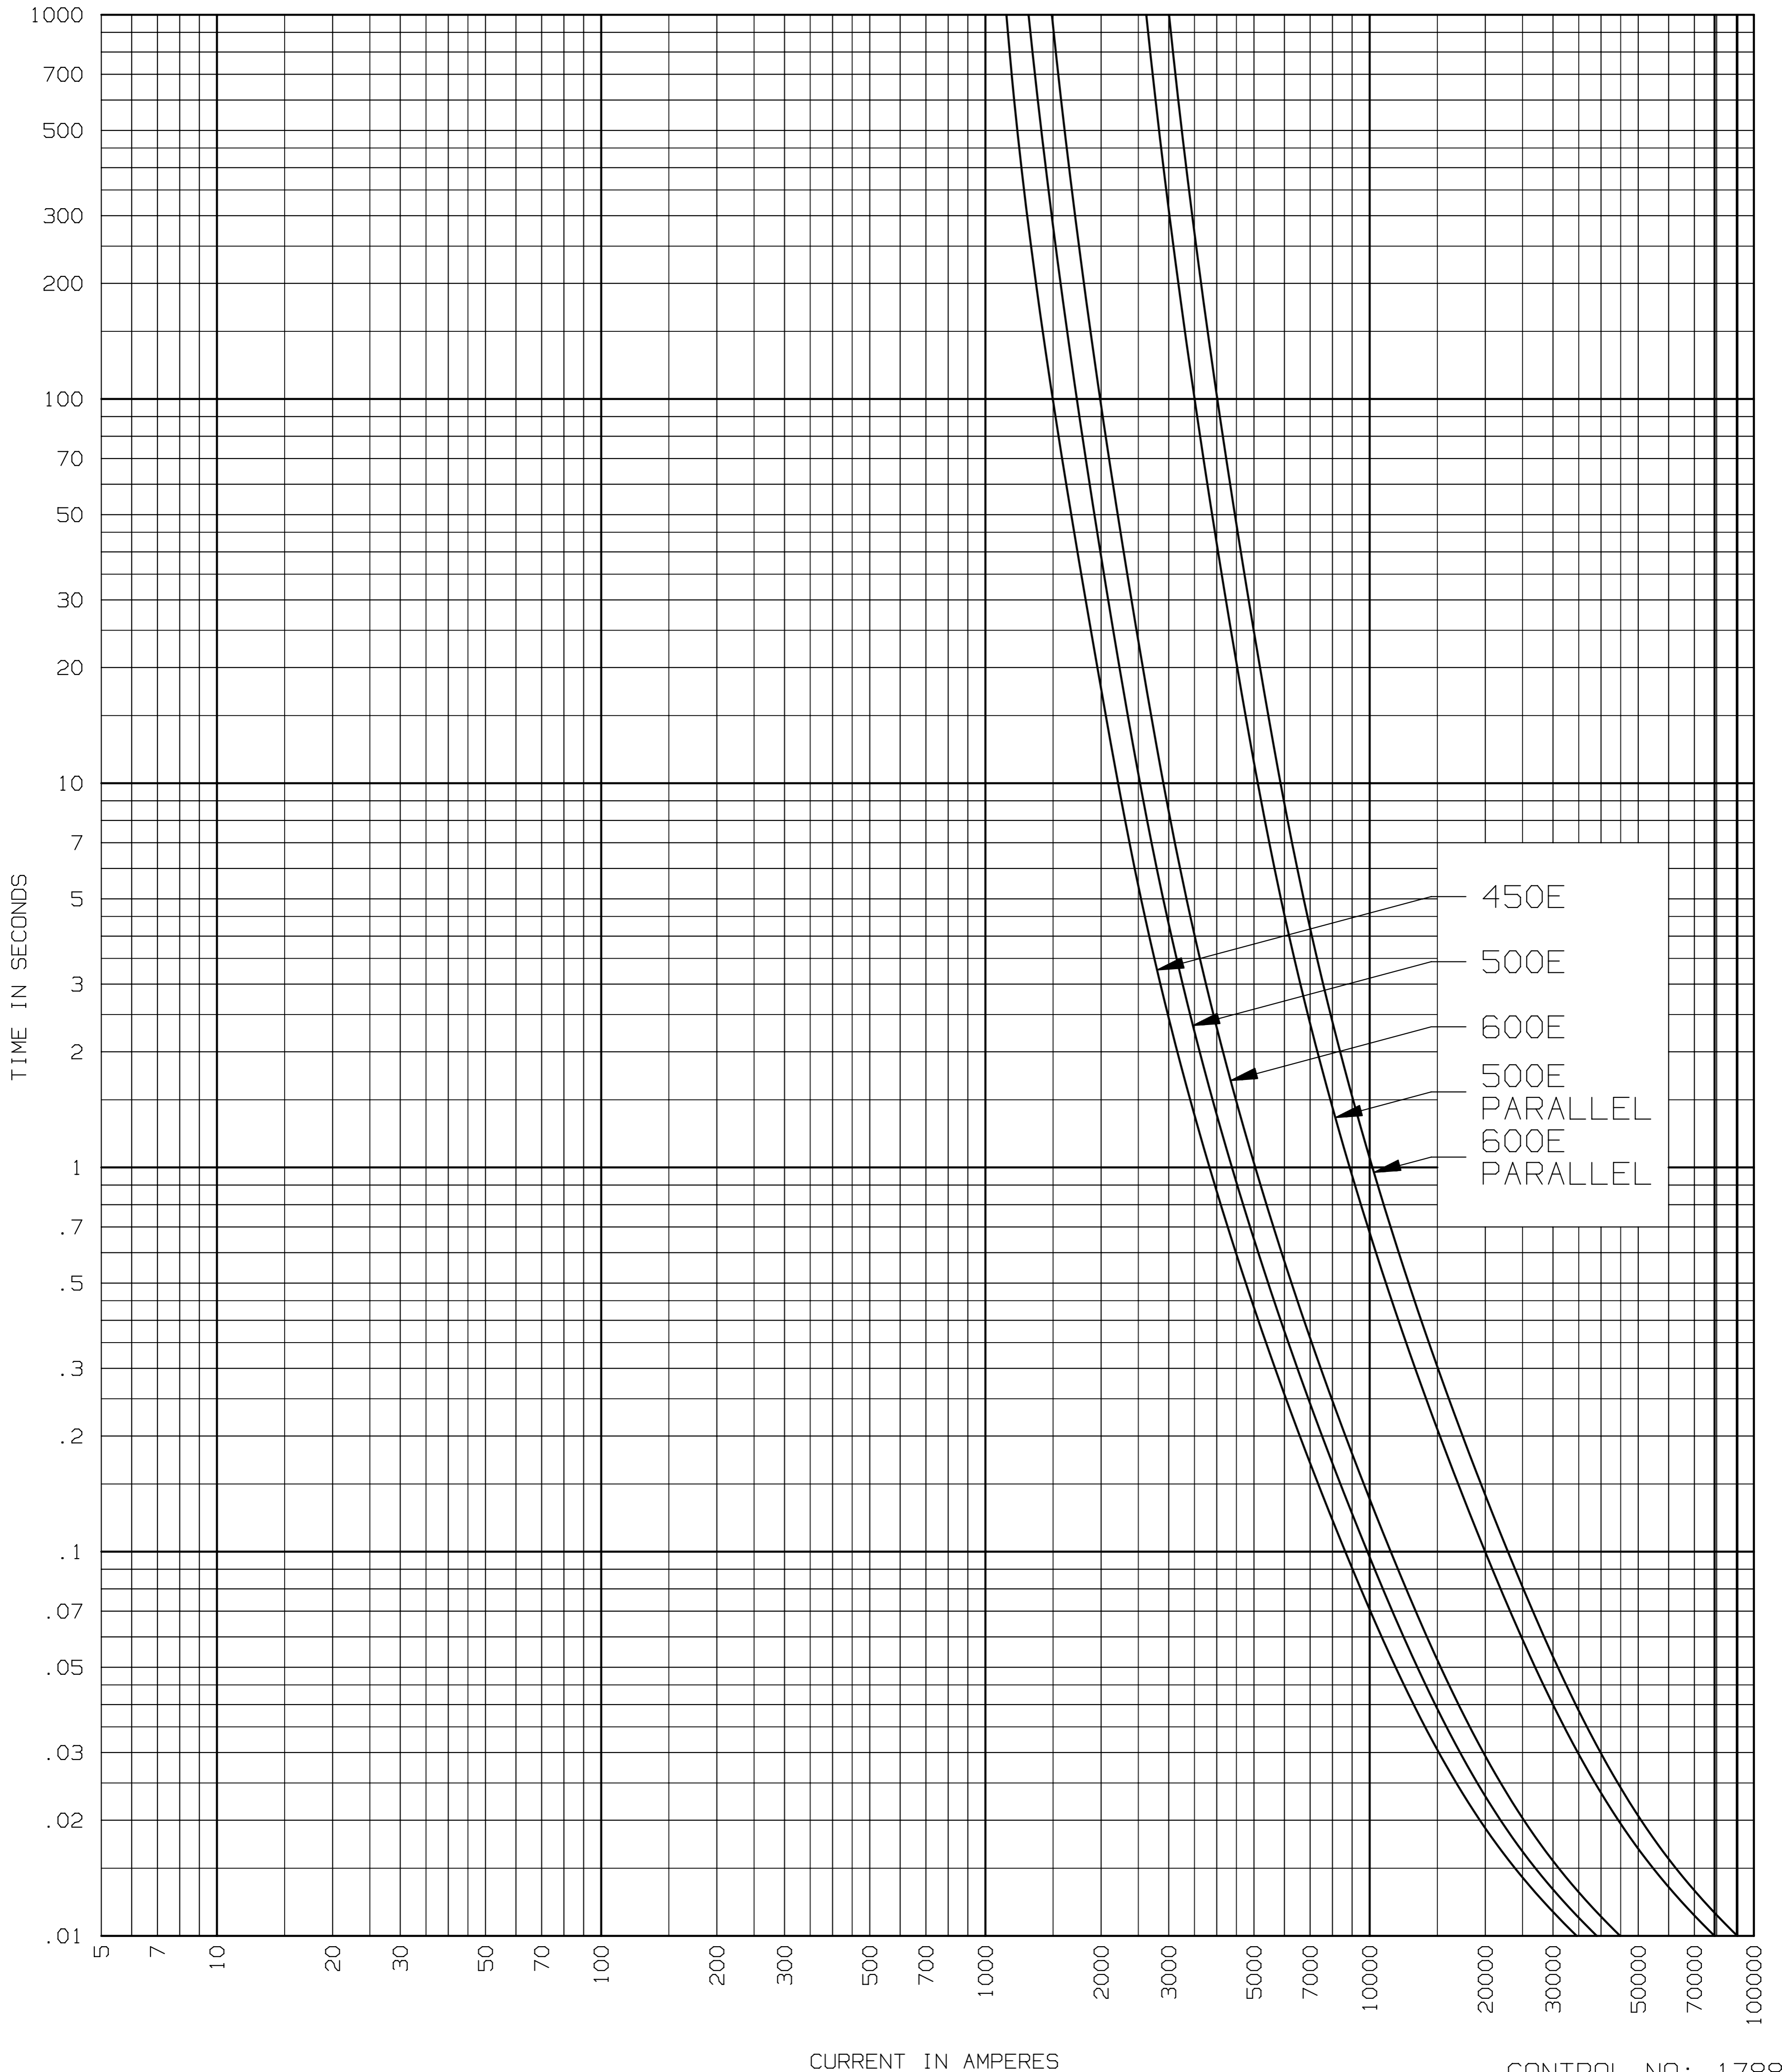

450E
500E
600E
500E PARALLEL
600E PARALLEL

CURRENT IN AMPERES

CONTROL NO: 1788
FOLDER NO. 5B
REV. B
5/16/16