

MEDIUM VOLTAGE AMP-TRAP FUSE

CL-14

A083C1D0R0-60E

60E 8.3KV


TOTAL CLEARING TIME CURRENT CURVE



Newburyport, MA 01950

720467

CURRENT IN AMPERES X10

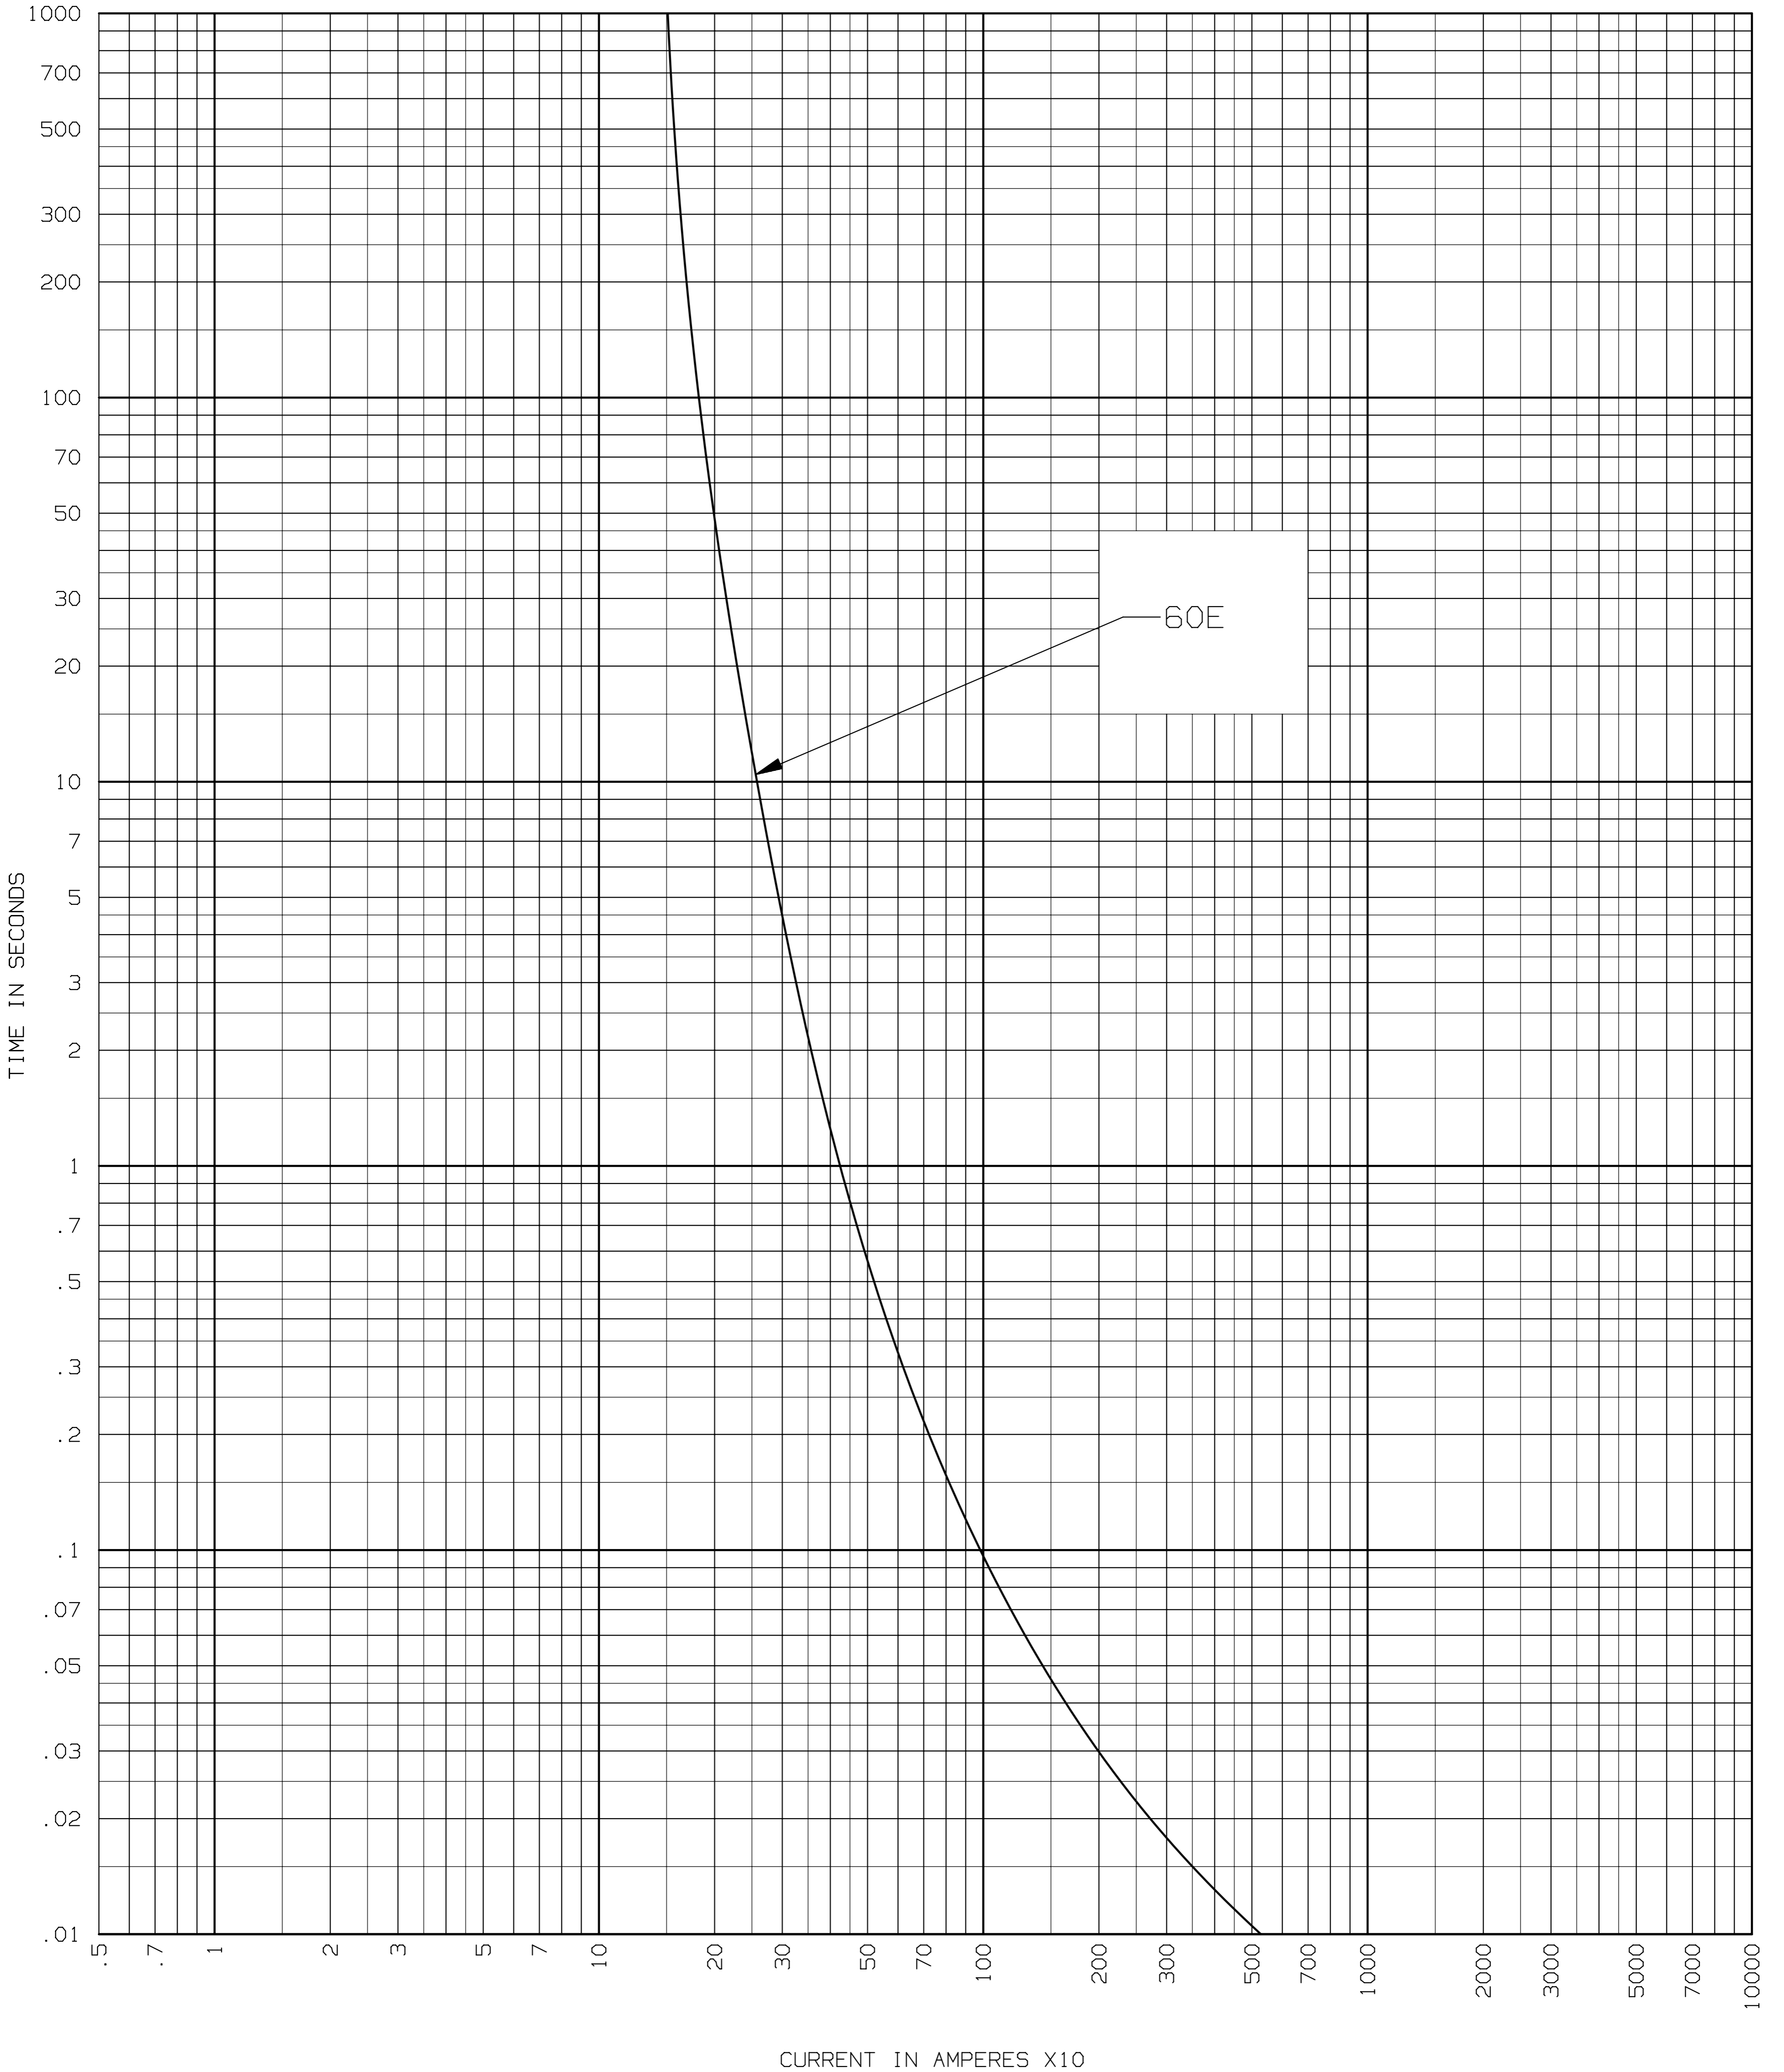

CONTROL No: 1802
FOLDER NO.: 14A
REV. B
6-17-16