


MEDIUM VOLTAGE CAPACITOR FUSE
CAT. NO. A300C(50-175) -10, -20, -60, -21
50-175A 3.0kV

MINIMUM MELTING TIME CURRENT DATA

Mersen
Newburyport, MA 01950
720545

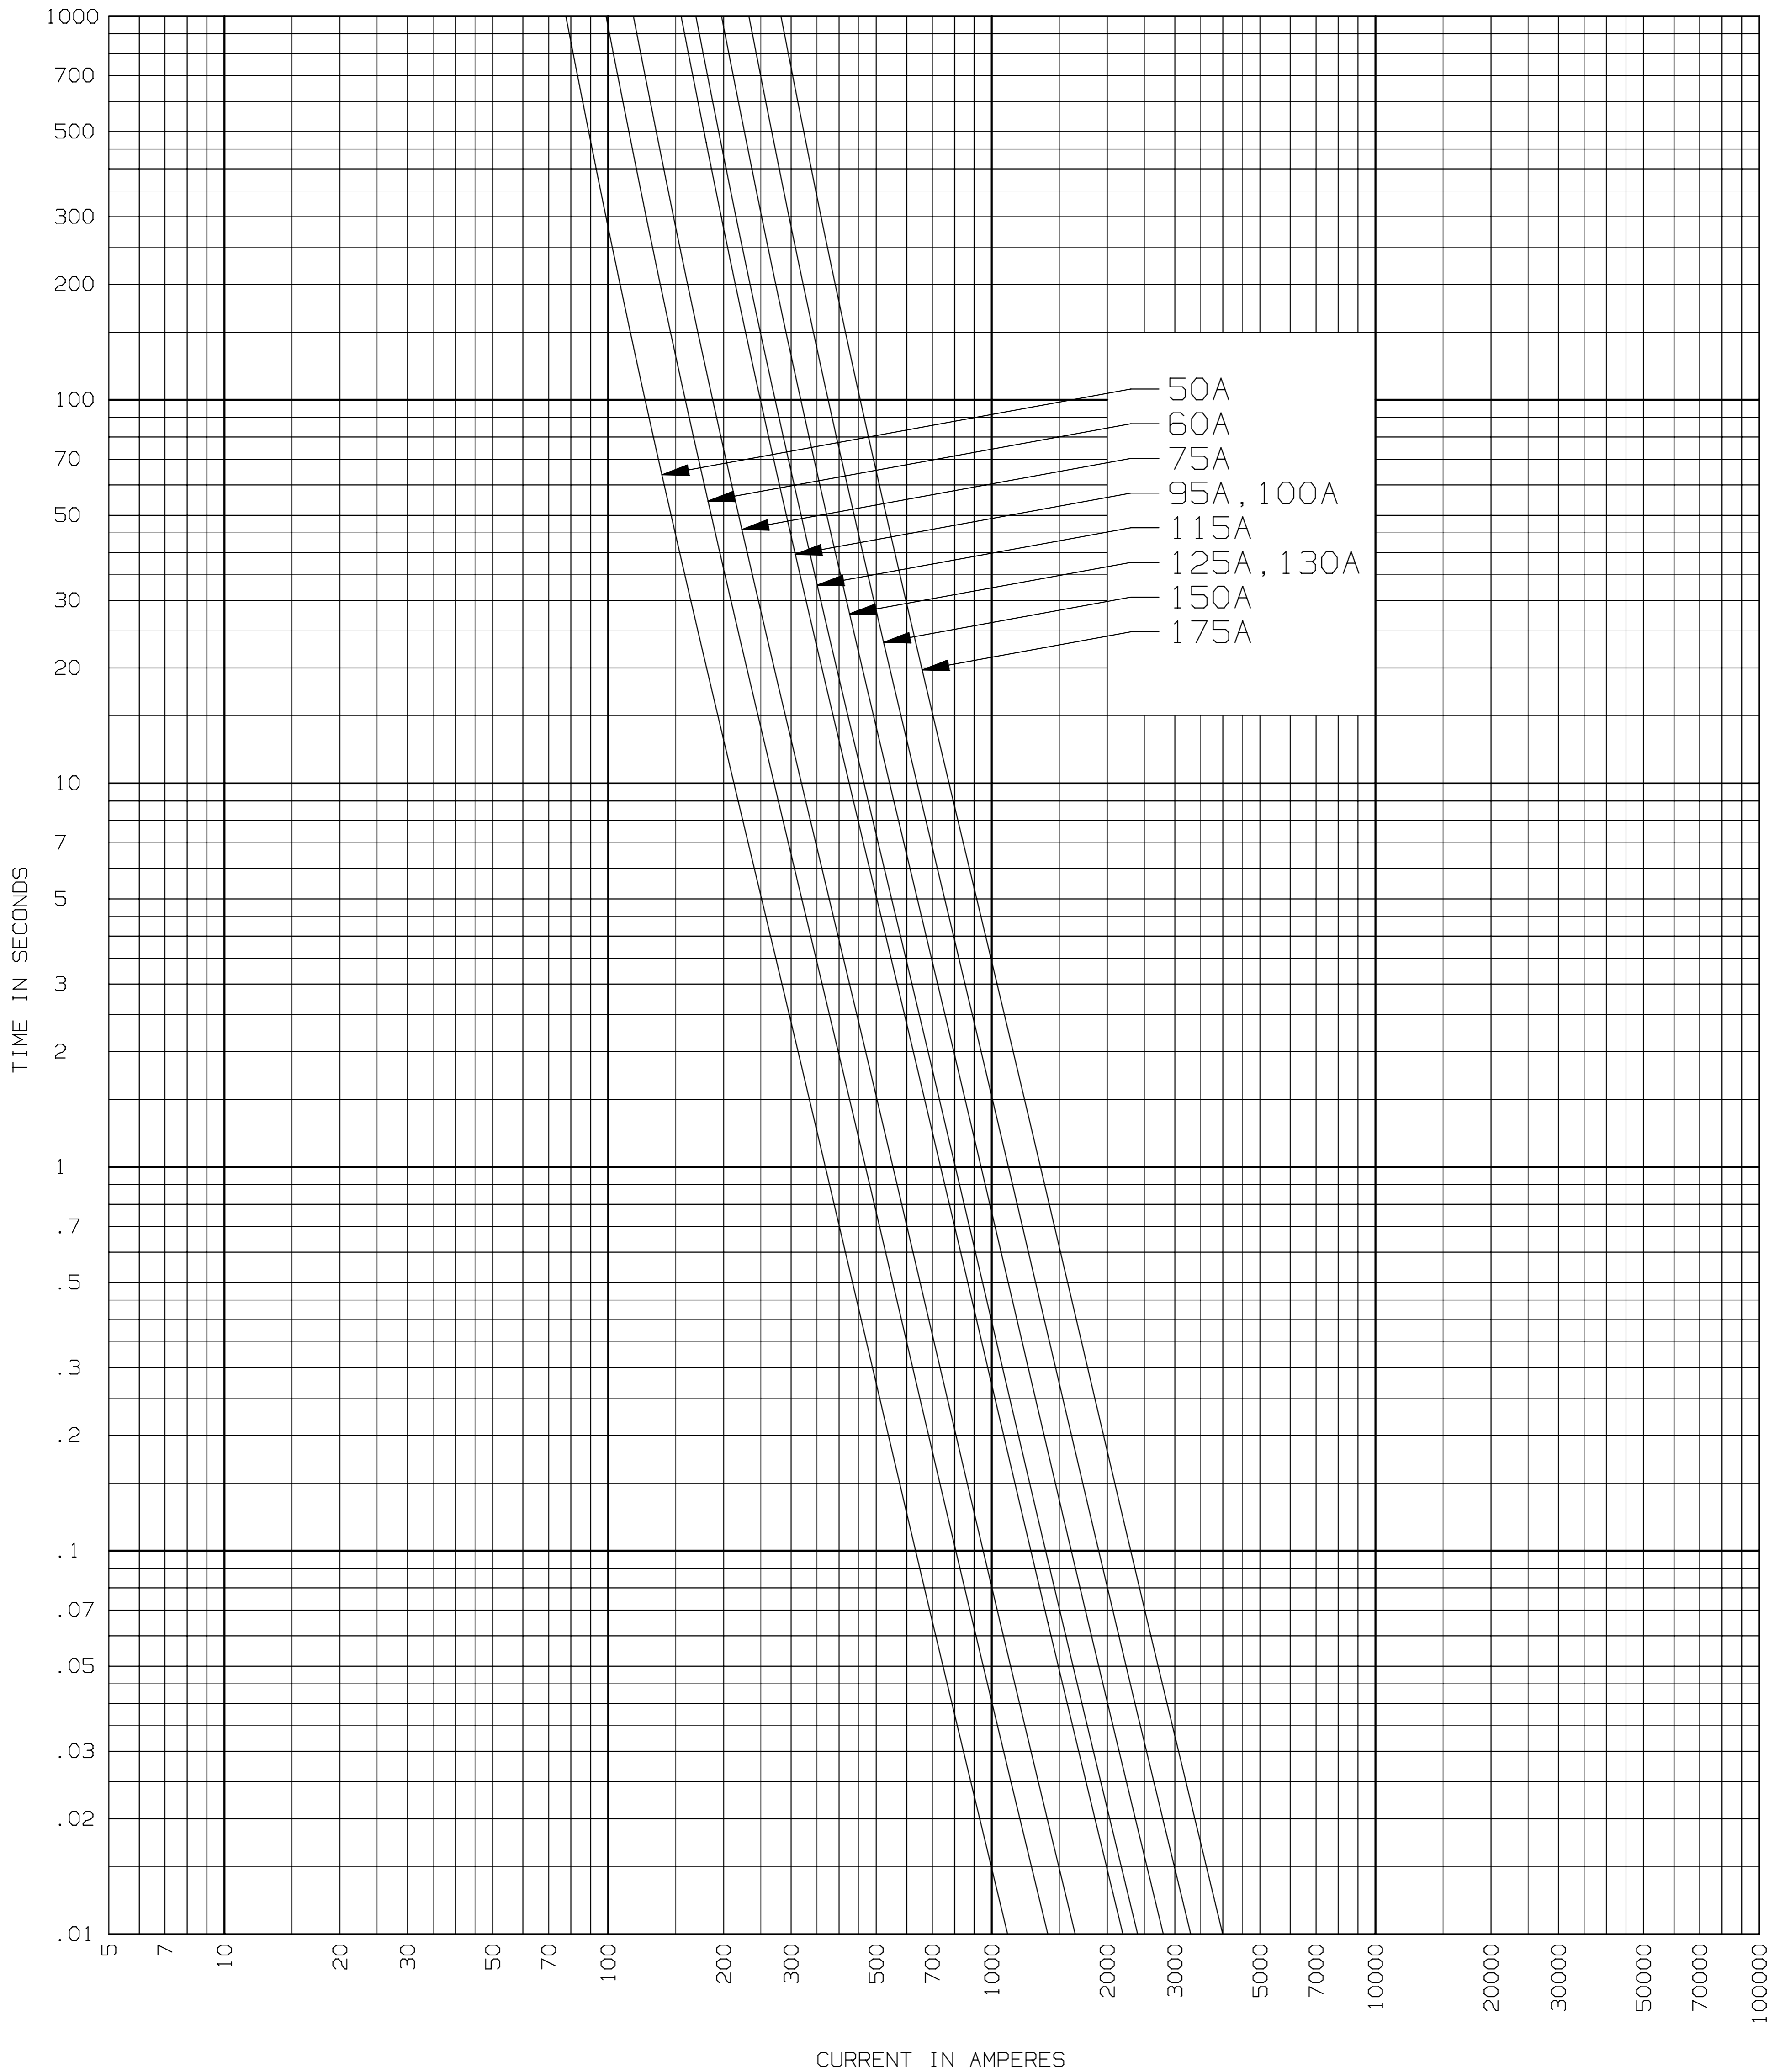

CONTROL NO.: 439
REV. A
FOLDER NO.: 47
10/31/06