


TIME DELAY CC FUSE

CAT. No. ATQR (AMP RATING)
15-30 AMPS 600V

AVERAGE MELTING TIME-CURRENT CURVE

MERSEN
Newburyport, MA 01950

720585

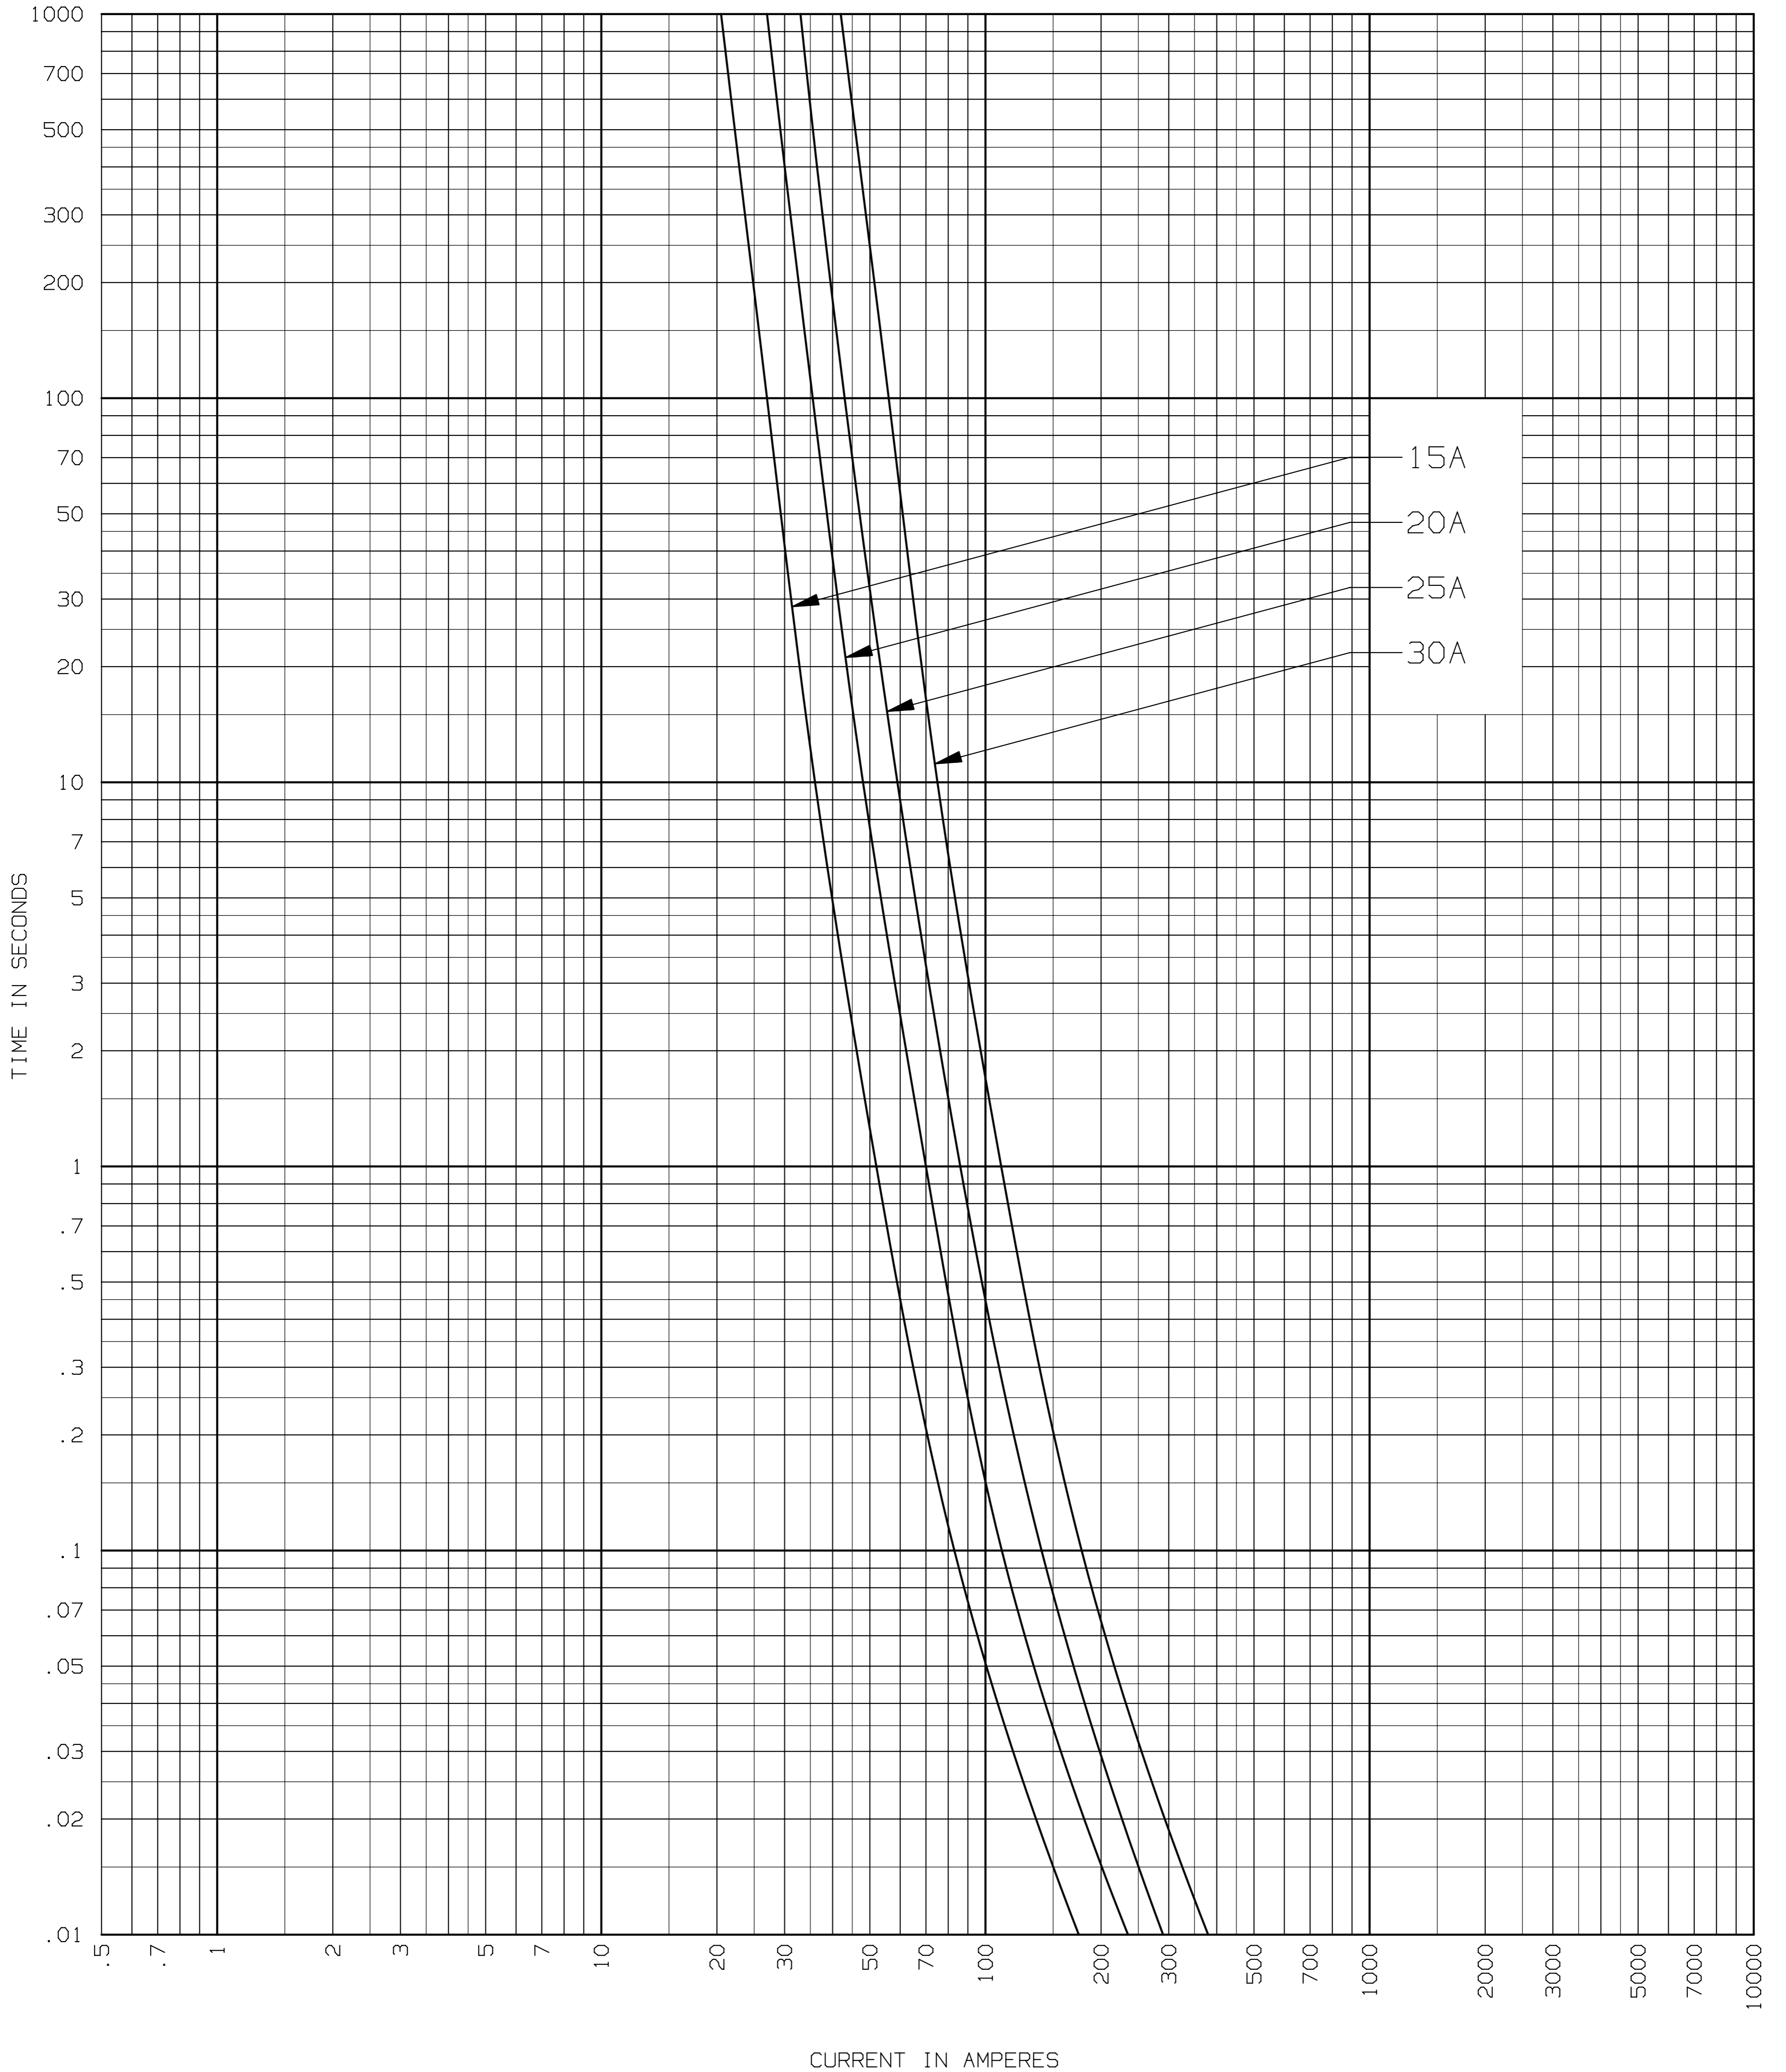

CONTROL NO.: 605
REV.: -

FOLDER NO.: 40D

08/13/04